
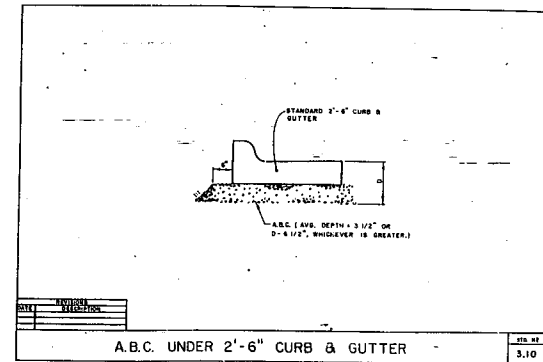
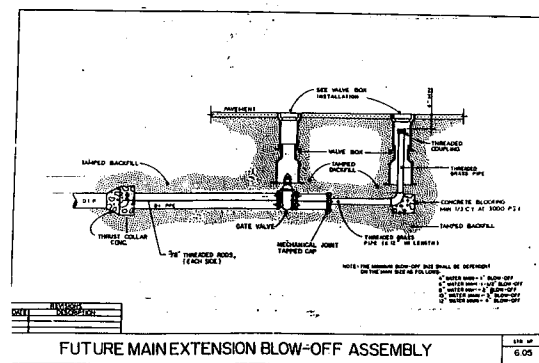
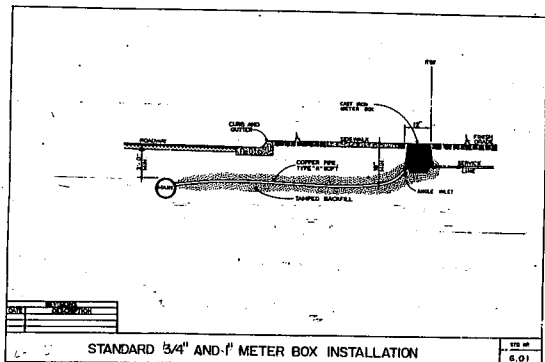
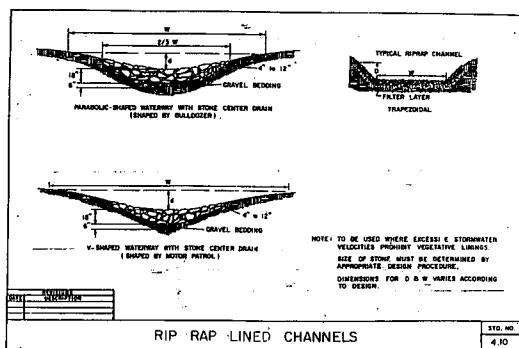
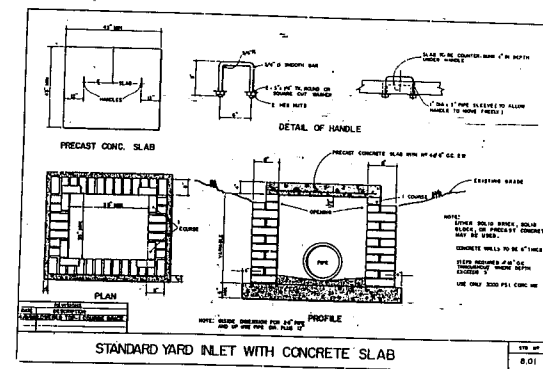
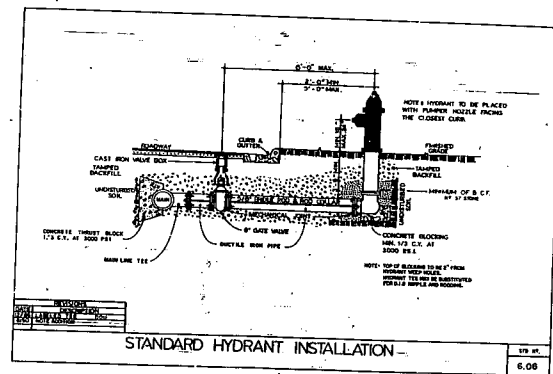
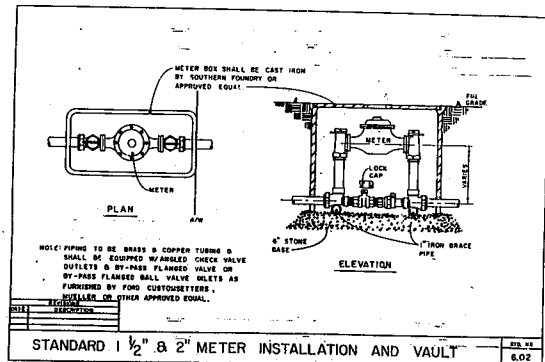
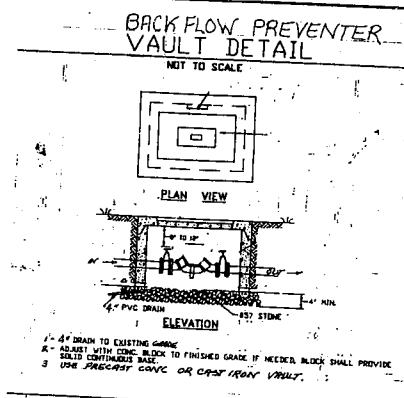
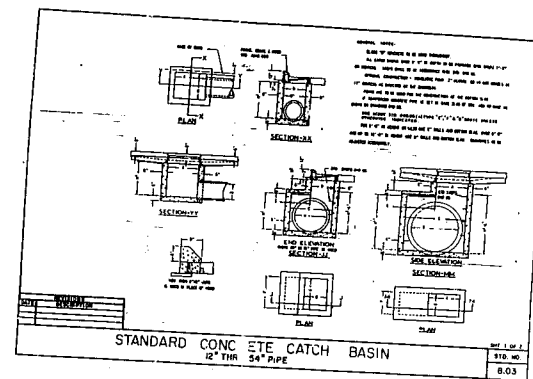
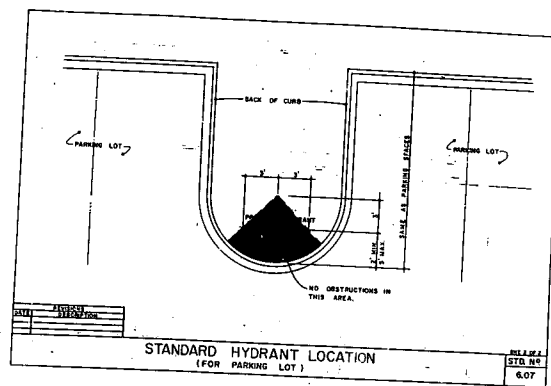


**MINIMUM CONCRETE BLOCKING (C.Y.)**

PIPE DIA. IN.	MIN. DEAD END	MIN. REACT	MIN. REACT	MIN. REACT	MIN. REACT
4	1/2	1/2	1/2	1/2	1/2
6	1/2	1/2	1/2	1/2	1/2
8	1/2	1/2	1/2	1/2	1/2
10	1/2	1/2	1/2	1/2	1/2
12	1/2	1/2	1/2	1/2	1/2
14	1.0	1.0	1.0	1.0	1.0
16	1.5	1.5	1.5	1.5	1.5
18	1.5	1.5	1.5	1.5	1.5
20	1.5	1.5	1.5	1.5	1.5
24	1.5	1.5	1.5	1.5	1.5

STANDARD REACTION BLOCKING STD NO. 6.12

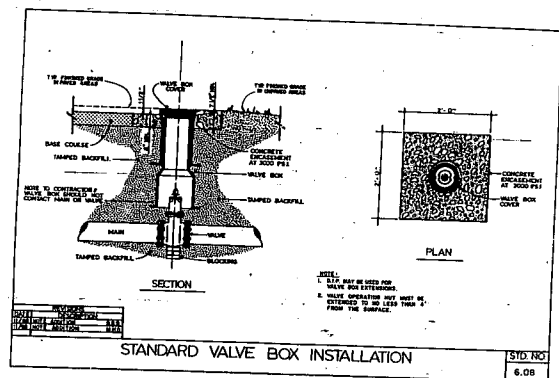

Murphy, Sells Associates  
 Registered Professional Engineers  
 1000 J. ROBERT DRIVE  
 CHARLOTTE, NC 28203  
 (704) 366-7953

CONSTRUCTION DETAILS  
 SHEET 3 OF 4

AERIAL CENTER PARKWAY SEC. 2 PHASE 2  
 AERIAL CENTER EXECUTIVE PARK  
 CARY, WAKE CO., NORTH CAROLINA