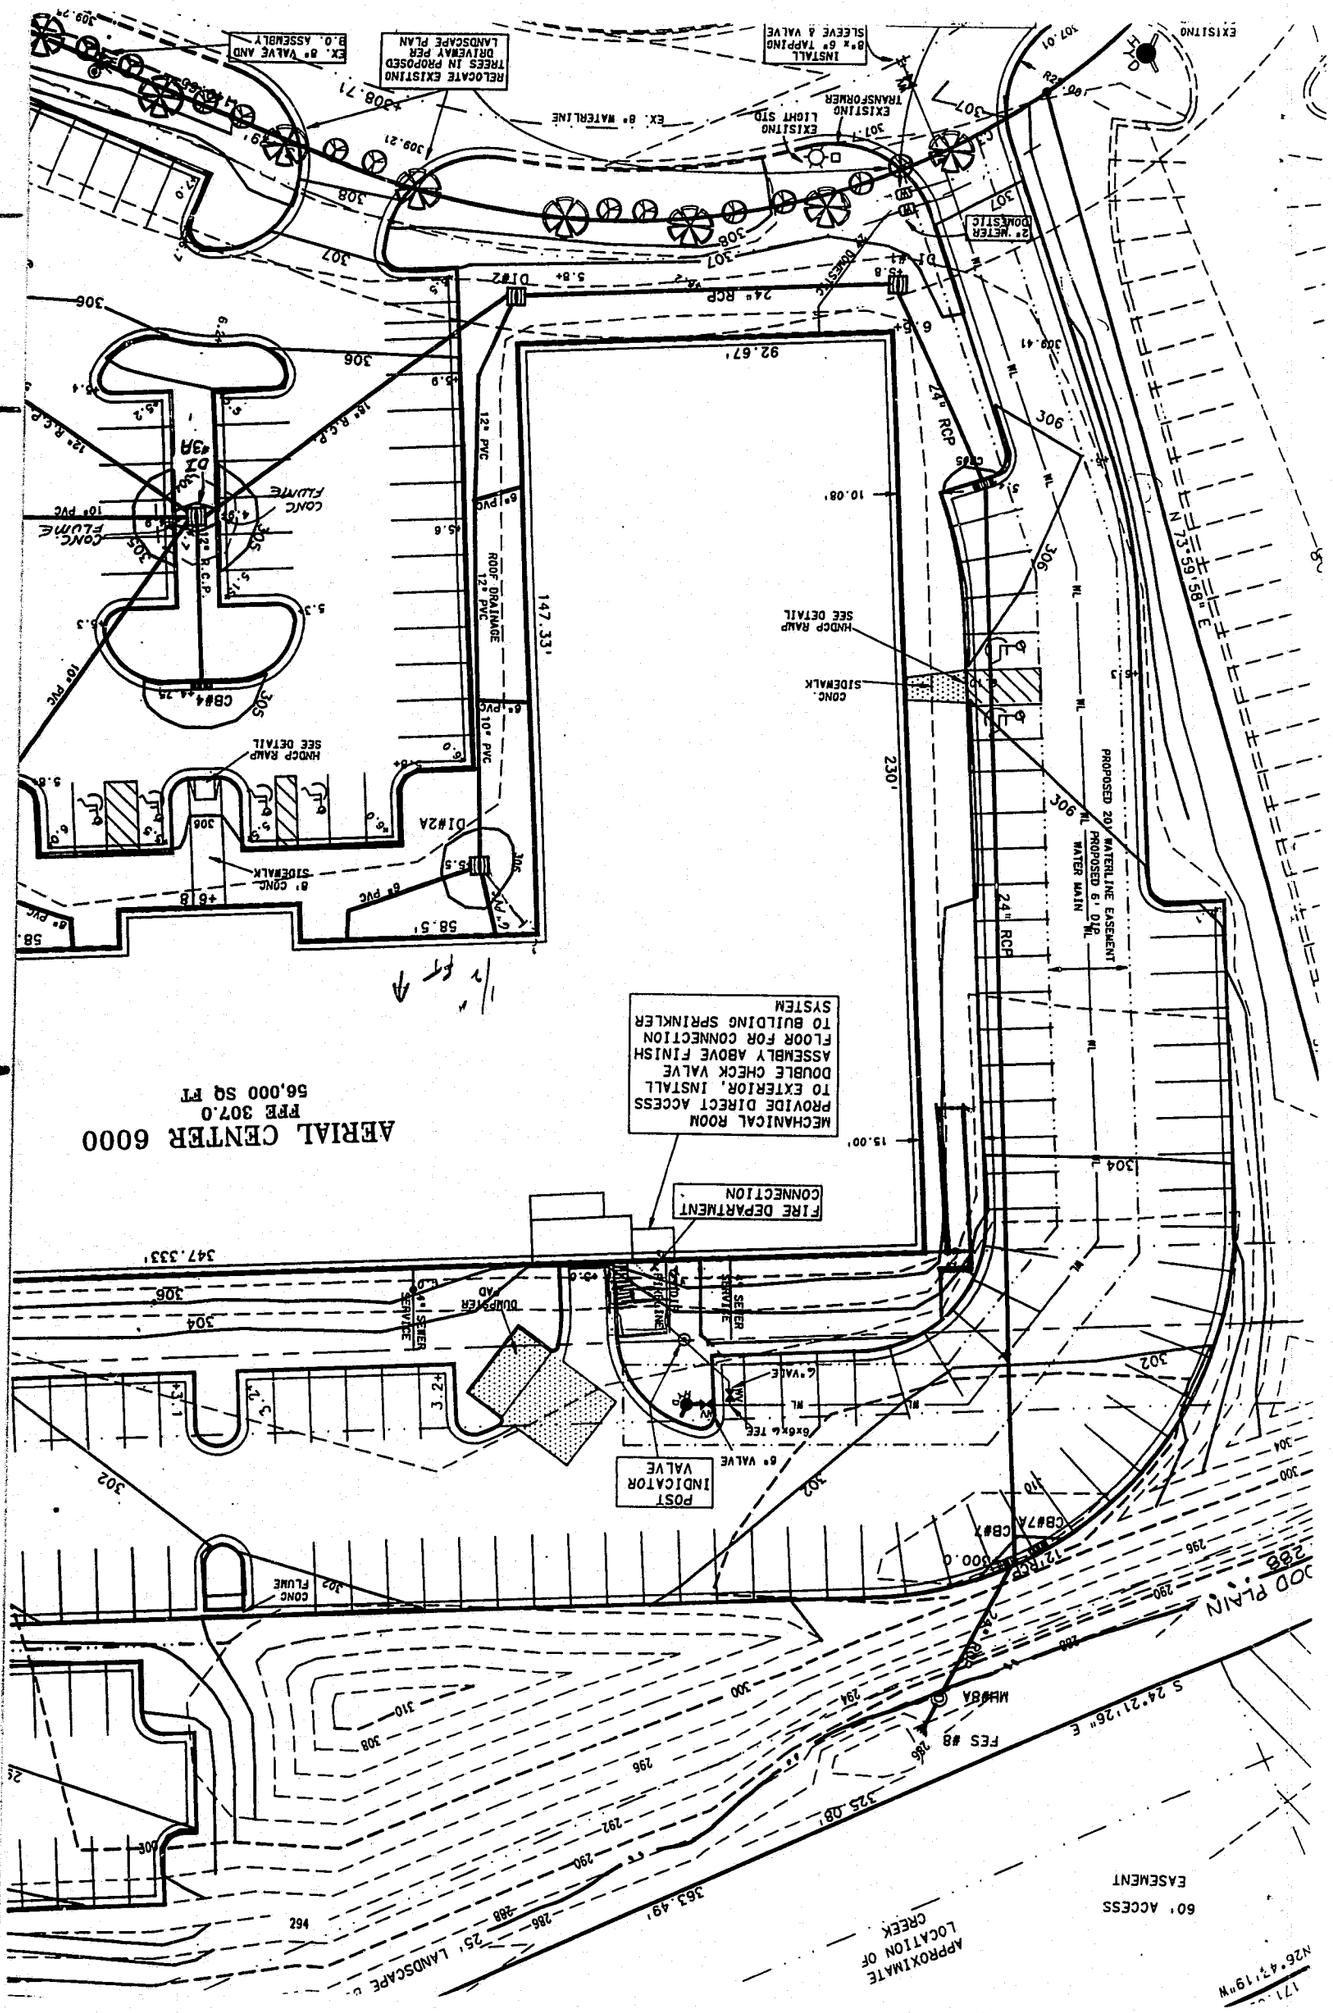
AERIAL CENTER 6000
FFE 307.0
56,000 SQ FT
MECHANICAL ROOM
PROVIDE DIRECT ACCESS
TO EXTERIOR. INSTALL
DOUBLE CHECK VALVE
ASSEMBLY ABOVE FINISH
FLOOR FOR CONNECTION
TO BUILDING SPRINKLER
SYSTEM
FIRE DEPARTMENT
CONNECTION
POST
INDICATOR
VALVE
PROPOSED 20' WATERLINE EASEMENT
PROPOSED 6" DIP
WATER MAIN
24" RCP
HMDCP RAMP
SEE DETAIL
SIDEWALK
CONC.
RELOCATE EXISTING
TREES IN PROPOSED
DRIVEWAY PER
LANDSCAPE PLAN
EX. 8" VALVE AND
B.O. ASSEMBLY
EX. 8" WATERLINE
EXISTING
LIGHT STD
EXISTING
TRANSFORMER
INSTALL
8"x 6" TAPPING
SLEEVE & VALVE
2" METER
DOMESTIC
24" RCP
12" PVC
6" PVC
ROOF DRAINAGE
12" PVC
10" PVC
CONC FLUME
CB#4
DI#2A
DI#3A
DI#2
CB#7A
CB#7
MH#8A
FES #8
8" CONC. SIDEWALK
8" PVC
6"x6" TEE
6" VALVE
92.67'
147.33'
230'
58.5'
N 73°59'58" E
S 24°21'26" E
N26°47'19"W
60' ACCESS
EASEMENT
APPROXIMATE
LOCATION OF
CREEK
FINISH FLOOD PLAIN
96-SP-155