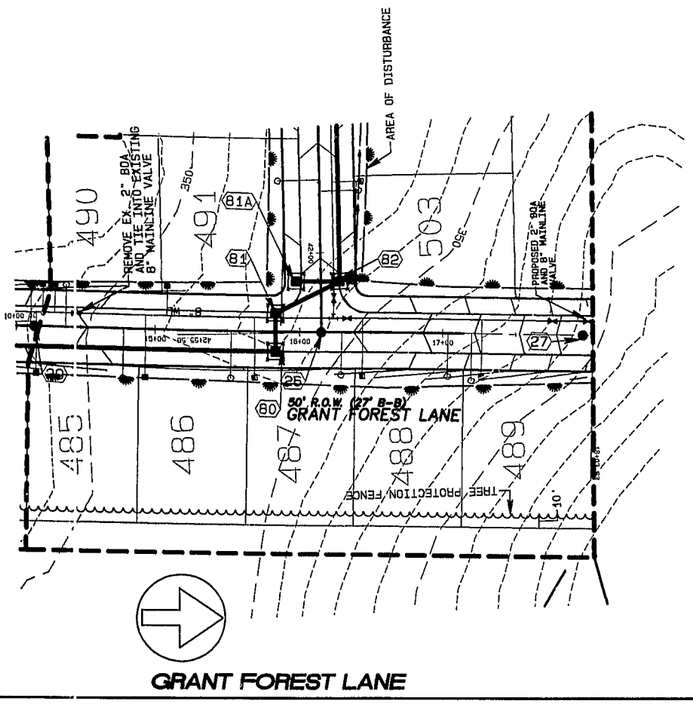

GRANT FOREST LANE

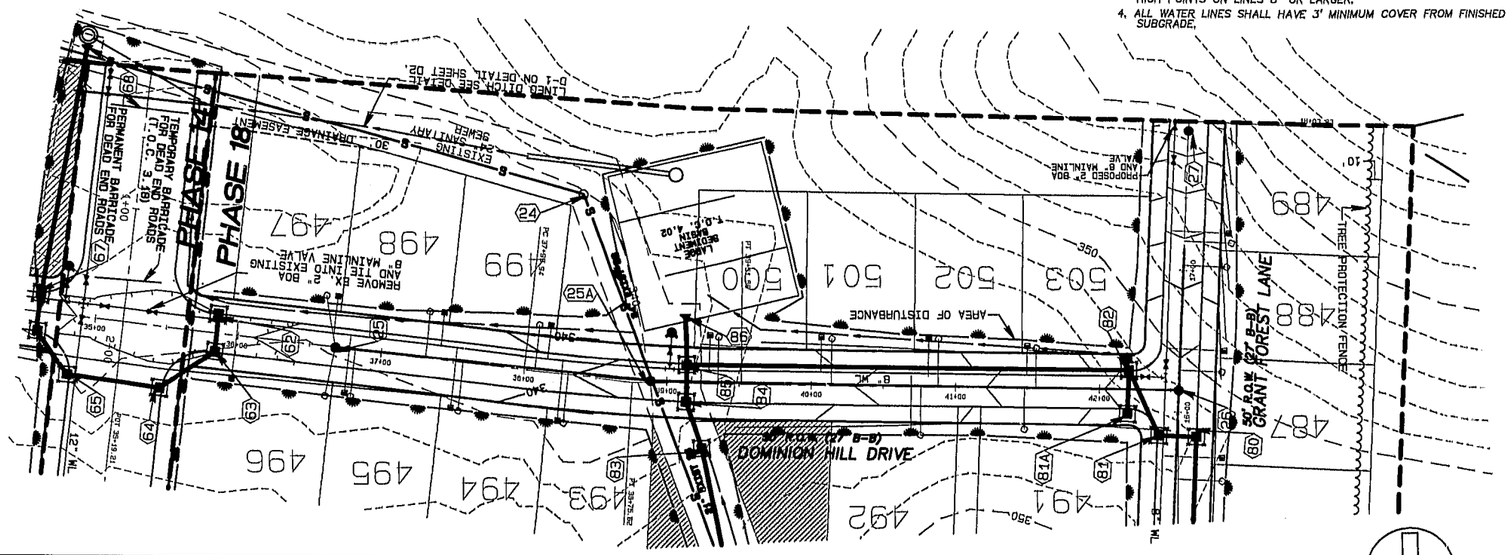

GRAPHIC SCALE 1"=50'

0 50 100 150

NOTES:

1. WATER LINE MATERIAL SHALL BE DIP.
2. SANITARY SEWERS SHALL BE LAID AT LEAST 10' LATERALLY FROM EXISTING OR PROPOSED WATER MAINS UNLESS THE TOP OF THE SEWER MAIN IS AT LEAST 18" BELOW THE BOTTOM OF THE WATER MAIN AND THERE IS A HORIZONTAL SEPARATON OF AT LEAST 3'. MAINTAIN AT LEAST 12" BETWEEN THE TOP OF SANITARY SEWER MAINS AND THE BOTTOM OF STORM SEWER PIPES.
3. AIR RELEASE VALVES SHALL BE INSTALLED AT ALL WATER LINE HIGH POINTS ON LINES 8" OR LARGER.
4. ALL WATER LINES SHALL HAVE 3' MINIMUM COVER FROM FINISHED SUBGRADE.

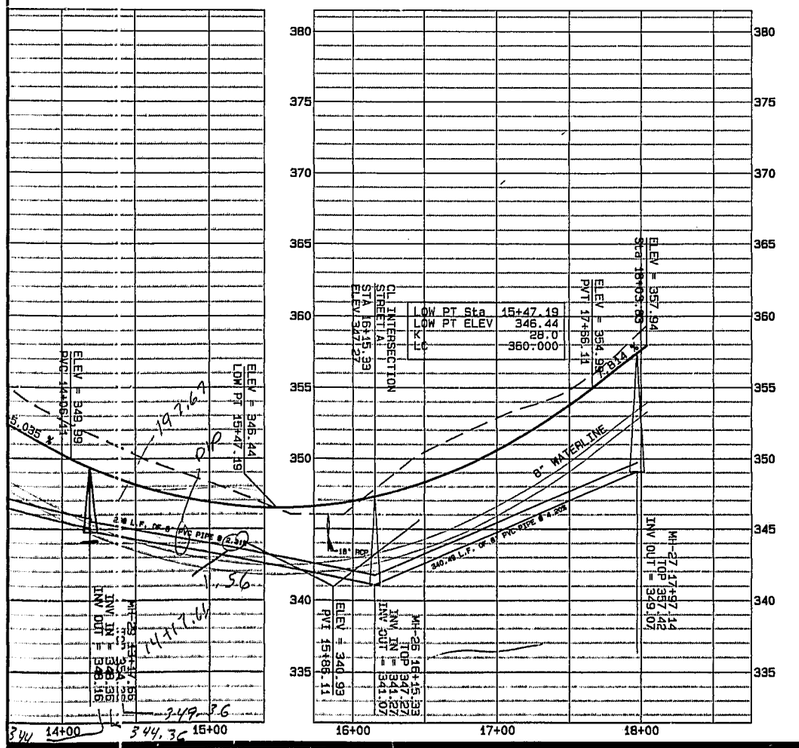

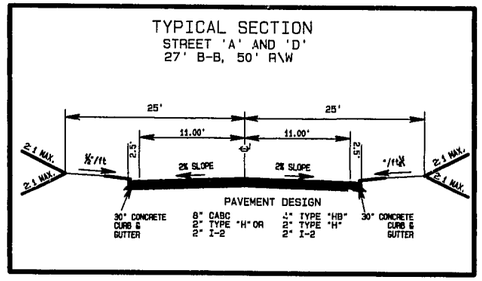

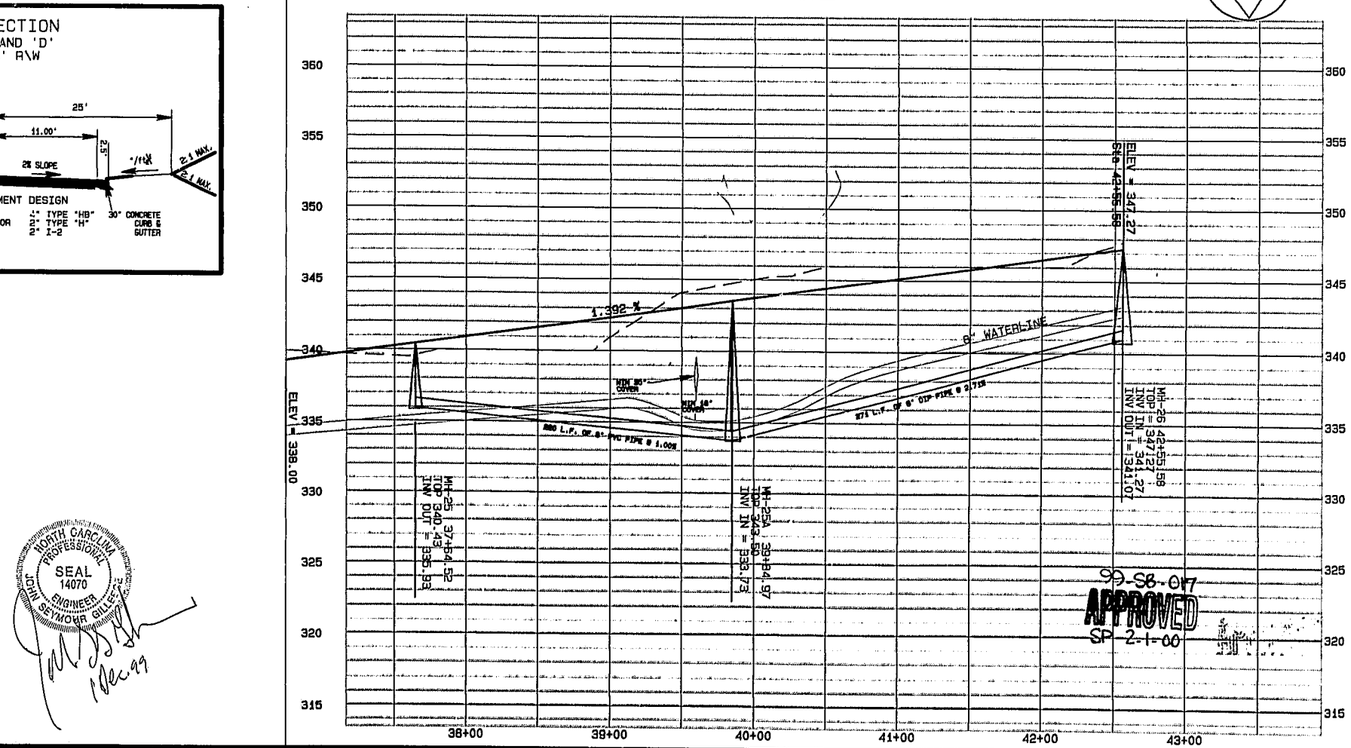

99-SB-017
APPROVED
SP 2-1-00

NORTH CAROLINA PROFESSIONAL SEAL 14070 ENGINEER JOHN SEYMOUR GILLEECE

Dec. 99

CARPENTER VILLAGE PHASE 18

PROFILE

Hugh J. Gilleece and Associates
875 Walnut St. Suite 350 Cary, NC ph(919)469-1101 fax(919)460-7637

Revisions: X

(H) Scale: 1"=50'
(V) Scale: 1"=5 ft.
G:\3690\CV18A1.PRO

Designed by:
Drawn by:
Date: 12/2/1999

Sheet: 5