
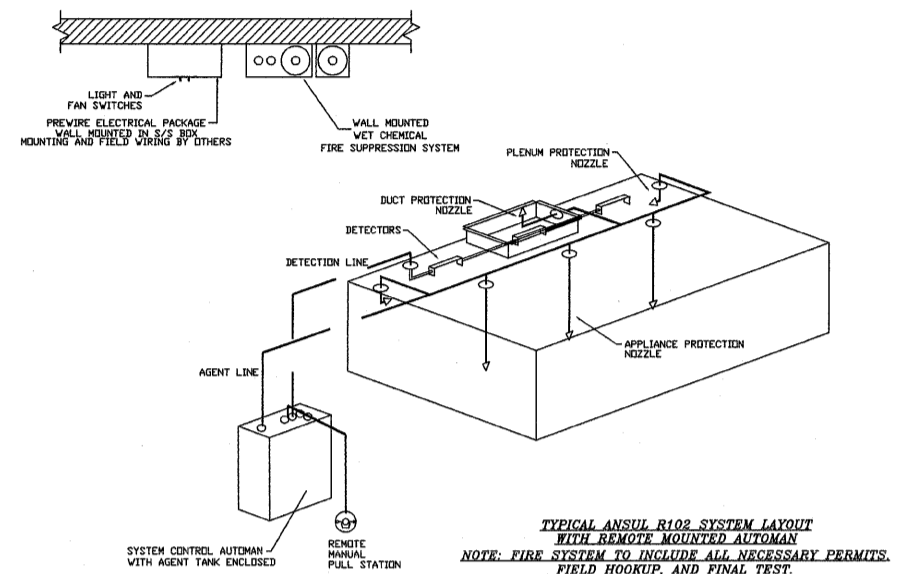


Z:\2006\06153\HRI.dwg Aug 14, 2006 - 9:37am

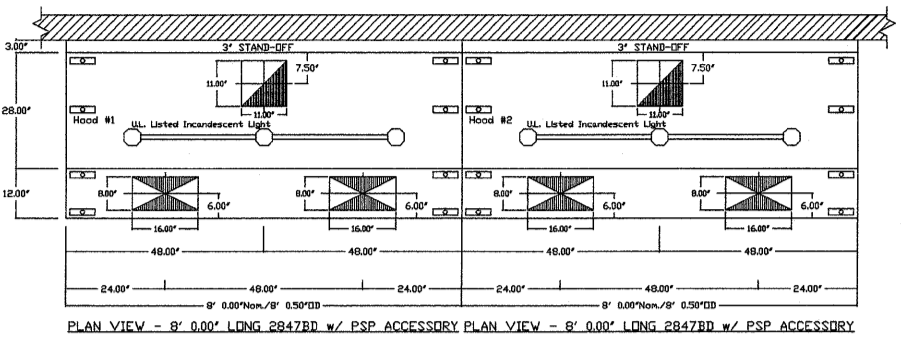

HOOD INFORMATION


HOOD NO.	TYPE	QTY	HEIGHT	LENGTH	WIDTH	WEIGHT	FINISH	NOTES
1	Alum. Baffle w/ Handle	1	12"	16"	36"	299	SS	
2	Alum. Baffle w/ Handle	1	12"	16"	36"	299	SS	
3		0				90	SS	
4		0				90	SS	

PERFORATED SUPPLY PLENUM(S)

HOOD NO.	POS.	LENGTH	WIDTH	HEIGHT	WIDTH	LENGTH	DIA.	CFM	S.P.
3	Front	96"	12"	6"	8"	16"	461	0.078"	
4	Front	96"	12"	6"	8"	16"	461	0.078"	

HOOD OPTIONS

HOOD NO.	OPTION	DESCRIPTION
1	BACK STANDOFF	3" Wide
1	BACKSPLASH	44.00" High X 96.00" Long 430 SS
1	FIELD WRAPPER	30.50" High Left, Right
1	BACKSPLASH	44.00" High X 96.00" Long 430 SS
2	BACK STANDOFF	3" Wide
2	BACKSPLASH	44.00" High X 96.00" Long 430 SS
2	FIELD WRAPPER	30.50" High Right, Left
2	BACKSPLASH	44.00" High X 96.00" Long 430 SS
3	FIELD WRAPPER	30.50" High Front, Left, Right
4	FIELD WRAPPER	30.50" High Front, Right, Left

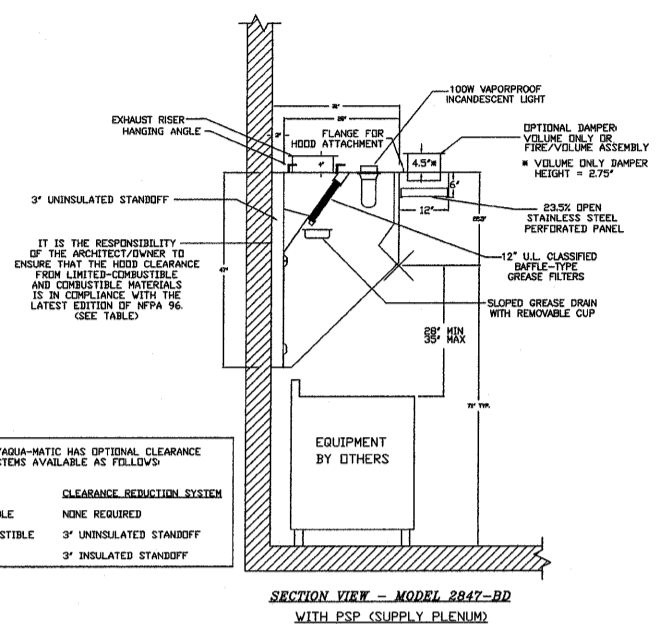

CAPTIVE-AIRE/AQUA-MATIC HAS OPTIONAL CLEARANCE REDUCTION SYSTEMS AVAILABLE AS FOLLOWS:

MATERIAL	CLEARANCE REDUCTION SYSTEM
NON-COMBUSTIBLE	NONE REQUIRED
LIMITED-COMBUSTIBLE	3" UNINSULATED STANDOFF
COMBUSTIBLE	3" INSULATED STANDOFF

CAPTIVE-AIRE HOODS ARE BUILT IN COMPLIANCE WITH

NFA #96 NSF ETL LISTED #3054804-001

FOR QUESTIONS, CALL:
CAPTIVE-AIRE SYSTEMS, INC.
MARK PROFET (800) 988-0881
KENDALL TARKINGTON (800) 419-1447
FAX (301) 986-1795 FAX (804) 684-0880

CAPTIVE-AIRE

JOB: FIVE GUYS BURGERS & FRIES
LOCATION: CARY, NC
DATE: 7/14/06
DWC # 714F1V1J
REV. 100

JOB # 0
DRAWN BY JMN
SCALE 3/4"

FAN INFORMATION

FAN UNIT NO.	FAN UNIT MODEL #	MODEL	TAG	CFM	S.P.	RPM	HP.	#	VOLT	FLA	BLOWER	HOUSING	TAG	CFM	S.P.	RPM	HP.	#	VOLT	FLA	
1	HRE-20	HRE-20		2630	-1.500"	1077	2.000	3	208	6.0	G10	AI-D-250		1046	0.375"	940	0.750	3	208	2.7	
2	AI-D-250-G10																				

FAN OPTIONS



FAN NO.	OPTION (Qty. - Descr.)
2	1 -Pressure Gauge, 0-35"

CURB ASSEMBLIES

NO.	ITEM	SIZE
1	# 1 Curb	28.000"W x 28.000"L x 20.000"H Vented Hinged
2	# 2 Curb	21.000"W x 71.000"L x 20.000"H Insulated

GAS FIRED MAKE-UP AIR UNIT(S)

FAN UNIT NO.	BTU's	TEMP. RISE	GAS TYPE
2	139958	70 deg F	Natural

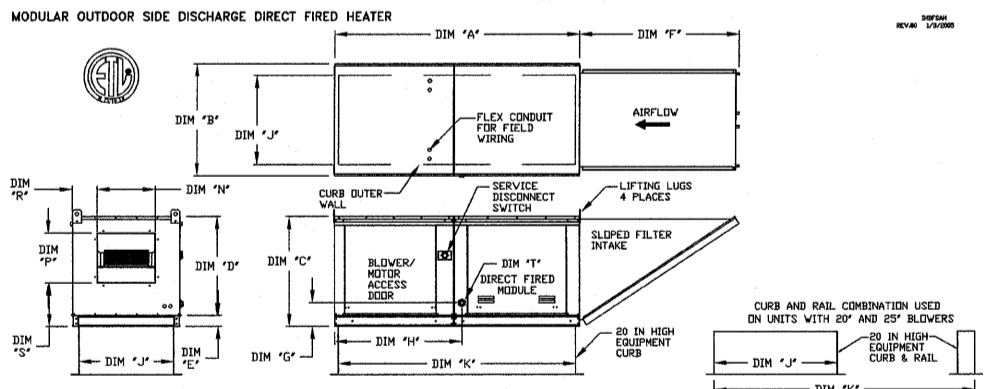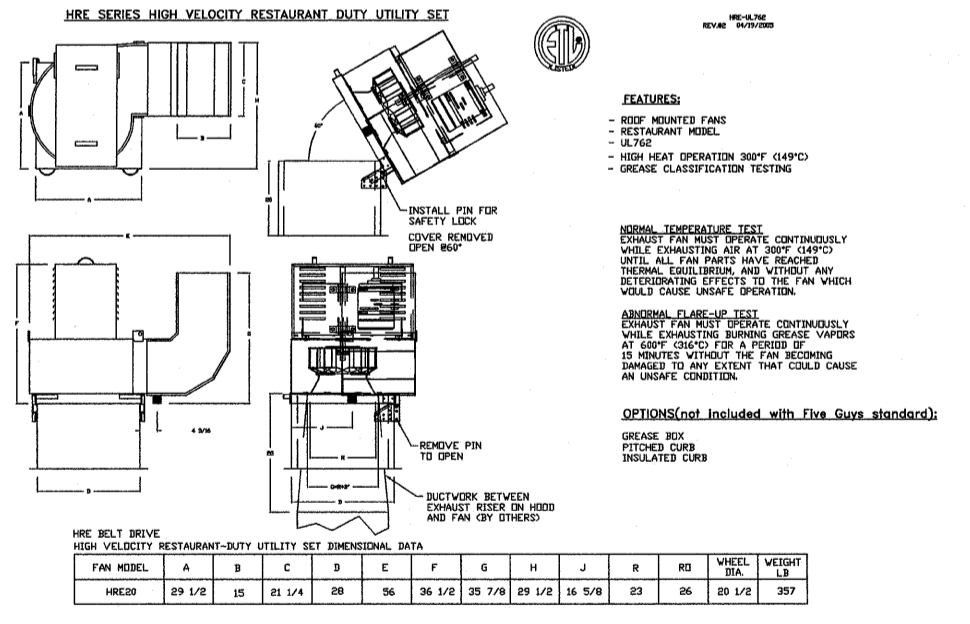

FOR QUESTIONS, CALL:
CAPTIVE-AIRE SYSTEMS, INC.
MARK PROFET (800) 988-0881
KENDALL TARKINGTON (800) 419-1447
FAX (301) 986-1795 FAX (804) 684-0880

CAPTIVE-AIRE

JOB: FIVE GUYS BURGERS & FRIES
LOCATION: CARY, NC
DATE: 7/14/06
DWC # 714F1V1J
REV. 100

JOB # 0
DRAWN BY JMN
SCALE 3/4"

THIS DRAWING IS PROVIDED FOR REFERENCE ONLY. HOOD CONTRACTOR SHALL SELECT AND CERTIFY ALL EXHAUST/M.U. AIR FANS. ALL SYSTEMS SHALL MEET ALL APPLICABLE REQUIREMENTS OF STATE AND LOCAL CODES AND OTHER REQUIREMENTS AS SHOWN IN DESIGN DRAWINGS.

	Sheet No. _____ CHECKED BY _____ DRAWN BY _____ PROJECT DATE 6/28/06	Revisions _____ _____ _____	FIVE GUYS FAMOUS BURGERS and FRIES	FIVE GUYS FAMOUS BURGERS AND FRIES Location: 712 S.E. MAYNARD ROAD CARY, NORTH CAROLINA Drawing: HOOD DETAILS	THESE STANDARD DESIGN DOCUMENTS AND SPECIFICATIONS ARE OWNED BY EDIMANN MIDLER HIRST ARCHITECT ASSOCIATES AND ARE NOT TO BE USED, COPIED OR DUPLICATED WITHOUT PROPER WRITTEN CONSENT. ANY UNAUTHORIZED USE OR DISCLOSURE OF THE PROPRIETARY INFORMATION CONTAINED HEREIN MAY SUBJECT SUCH PERSONS TO CRIMINAL AND CIVIL PENALTIES AND DAMAGES.	LHM Project No. 06153
			PROJECT DATE 6/28/06	Location: 712 S.E. MAYNARD ROAD CARY, NORTH CAROLINA		