
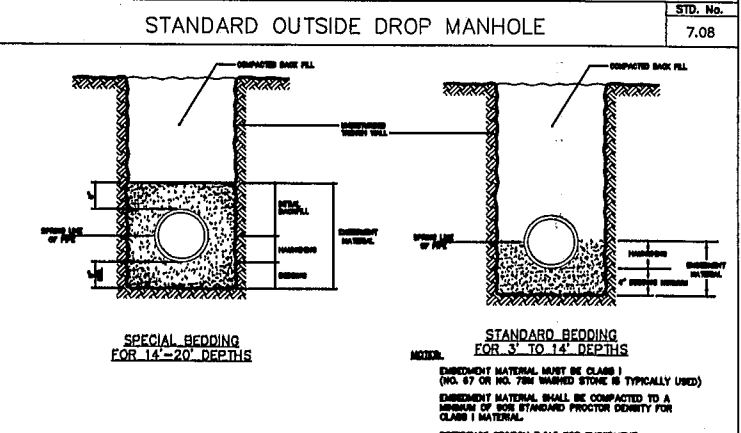
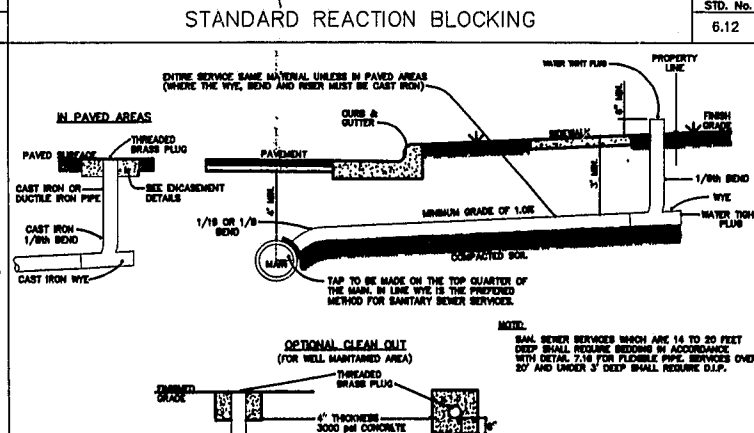
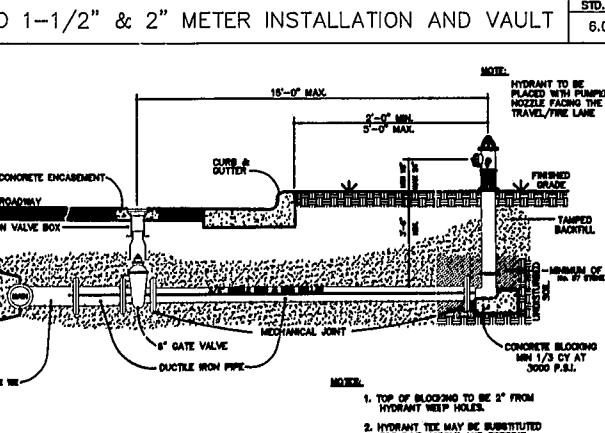


MINIMUM CONCRETE BLOCKING (C.Y.) *

NO. PIPE DIA. IN.	TEES & DEAD ENDS	8" BEND	4" BEND	22-1/2" BEND	11-1/4" BEND
4	1/3	1/3	1/3	1/3	1/3
6	1/3	1/3	1/3	1/3	1/3
8	1/3	1/2	1/3	1/3	1/3
10	2/3	3/4	1/2	1/3	1/3
12	3/4	1.0	2/3	1/3	1/3
14	1.0	1-1/2	3/4	1/2	1/3
16	1-1/3	2.0	1.0	1/2	1/3
18	1-2/3	2-1/3	1-1/3	2/3	1/3
20	2.0	3.0	1-2/3	3/4	1/2
24	3.0	4-1/3	2-1/3	1-1/3	2/3

* CONCRETE SHALL BE 3000 P.S.I. MIN.

STANDARD REACTION BLOCKING
6.12

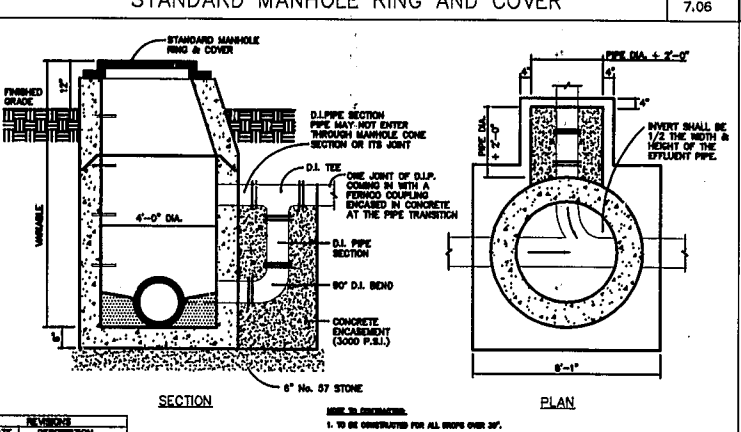

01-58-012
APPROVED
TOWN OF GARY

Approved By: DRC Date 5-22-02
Planning: BFB Date 4-13-02
Engineering: JS Date 6-12-02

BRADLEY D. HART
6/12/02

ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH CURRENT TOWN OF GARY STANDARD SPECIFICATIONS AND DETAILS

No.	Revision	Date	By	Designer	Scale
				BOH	1"=40'
				BOH	01MARCH02
				BOH	201238.00

THE GROVE AT CARY PARK

UTILITY & ROADWAY DETAILS

WITHERS & RAVENEL
ENGINEERS | PLANNERS | SURVEYORS

111 MacKenan Drive Cary, North Carolina 27511 tel: 919-469-3340 fax: 919-467-6000 www.wITHERSRAVENEL.COM

Sheet No. **C-8**