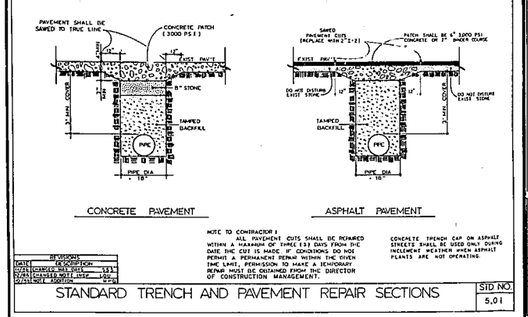

NOTE TO CONTRACTOR:
ALL PAVEMENT CUTS SHALL BE REPAIRED WITHIN A MAXIMUM OF THREE (3) DAYS FROM THE DATE THE CUT IS MADE. IF CONDITIONS DO NOT PERMIT A PERMANENT REPAIR WITHIN THE GIVEN TIME LIMIT, PERMISSION TO MAKE A TEMPORARY REPAIR MUST BE OBTAINED FROM THE DIRECTOR OF CONSTRUCTION MANAGEMENT.

CONCRETE TRENCH CAP ON ASPHALT STREETS SHALL BE USED ONLY DURING INCLEMENT WEATHER WHEN ASPHALT PLANTS ARE NOT OPERATING.

REVISIONS: DATE | DESCRIPTION — 7/25/90 | CHANGED MIN. DIST. 10'; 8/28/90 | CHANGED MIN. DIST. 15'; 9/27/90 | ADDITION

STANDARD TRENCH AND PAVEMENT REPAIR SECTIONS — STD NO 5.01

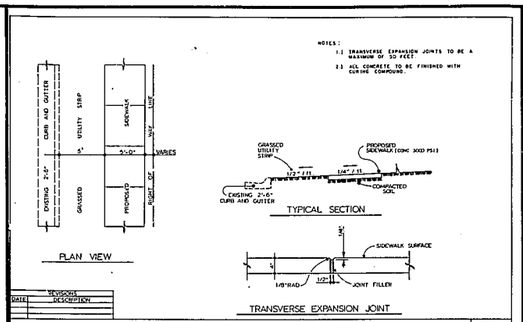

REVISIONS: DATE | DESCRIPTION

STANDARD CONCRETE SIDEWALK — STD NO 3.16

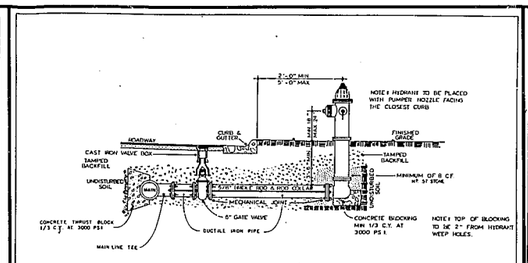

REVISIONS: DATE | DESCRIPTION — 9/27/90 | ADDED TEE

STANDARD HYDRANT INSTALLATION — STD NO 6.05

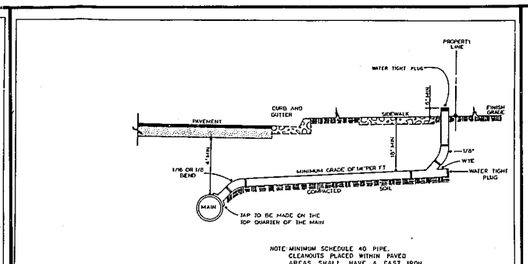

NOTE: MINIMUM SCHEDULE 40 PIPE.
CLEANOUTS PLACED WITHIN PAVED AREAS SHALL HAVE A CAST IRON STANDPIPE ABOVE THE WYE WITH A BRASS CAP.
SAN SEWER SERVICES WHICH ARE 14 TO 20 FEET DEEP SHALL REQUIRE BEDDING IN ACCORDANCE W/ DETAIL 7.19.
SERVICES OVER 20' DEEP SHALL REQUIRE D.I.P.

REVISIONS: DATE | DESCRIPTION — 9/27/90 | ADDITION OF DATA 4TH; 12/4/90 | ADDED 6" SEWER

STANDARD SANITARY SEWER TAP AND SERVICE — STD NO 7.01

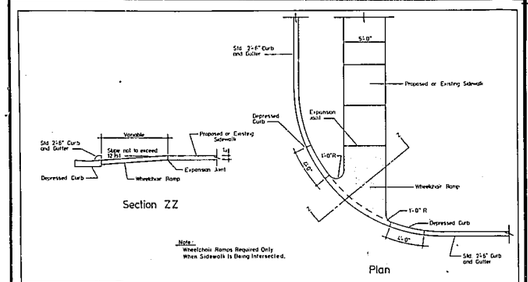

REVISIONS: DATE | DESCRIPTION — 9/27/90 | ADDITION

STANDARD WHEELCHAIR RAMP
SINGLE TYPE — STD NO 3.17

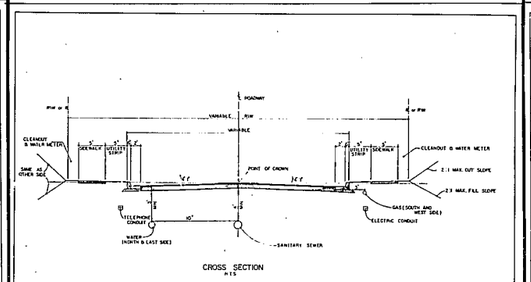

NOTE: THERE SHALL BE 18" VERTICAL SEPARATION BETWEEN WATER AND SEWER LINES

REVISIONS: DATE | DESCRIPTION — 9/27/90 | ADDITION OF SANITARY SEWER

STANDARD STREET CROSS SECTION
SHOWING UTILITY LOCATIONS — STD NO 3.07

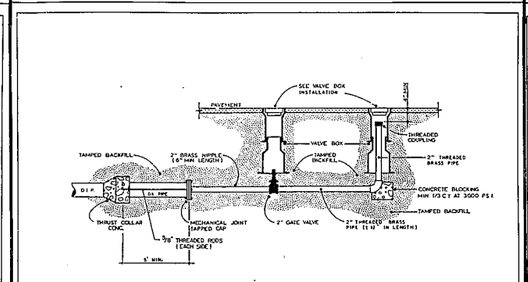

REVISIONS: DATE | DESCRIPTION — 5/3/90 | ELIMINATE NOTE

STANDARD 2" BLOW-OFF ASSEMBLY — STD NO 6.04

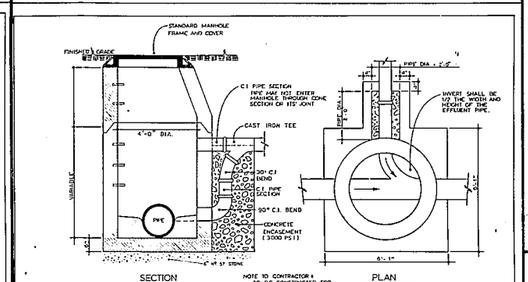

NOTE TO CONTRACTOR: TO BE CONSTRUCTED FOR ALL DROPS OVER 30"

PVC OR ABS FITTINGS MAY BE USED FOR THE DROP IF THE MAIN LINE IS ABS TRUSS PIPE OR PVC

REVISIONS: DATE | DESCRIPTION — 9/27/90 | ADDED 4TH NOTE

STANDARD OUTSIDE DROP MANHOLE — STD NO 7.08

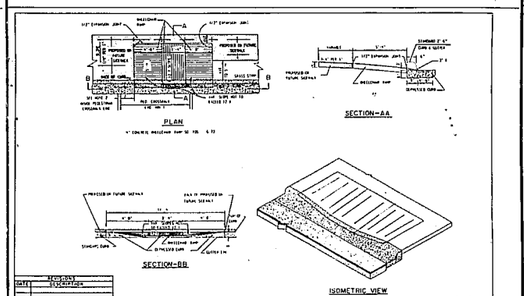

REVISIONS: DATE | DESCRIPTION

STANDARD WHEELCHAIR RAMP — SHEET 1 OF 2 — STD NO 3.18

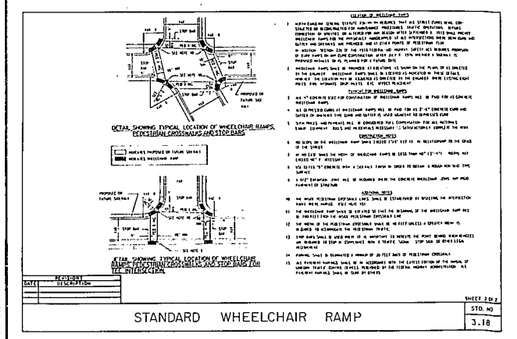

REVISIONS: DATE | DESCRIPTION

STANDARD WHEELCHAIR RAMP — SHEET 2 OF 2 — STD NO 3.18

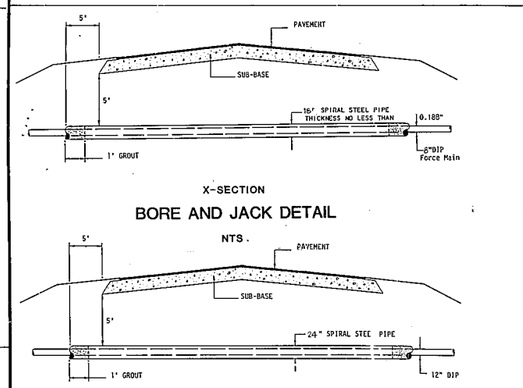

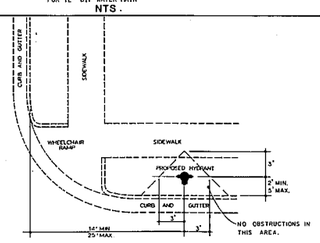

STANDARD HYDRANT LOCATION

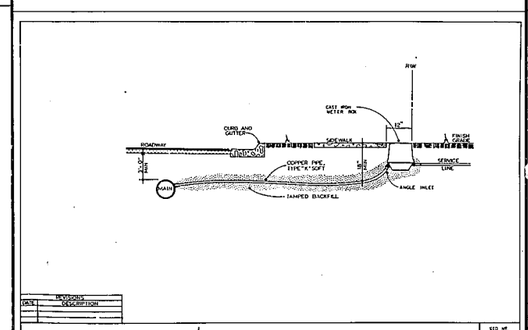

REVISIONS: DATE | DESCRIPTION

STANDARD 3/4" AND 1" METER BOX INSTALLATION — STD NO 6.01

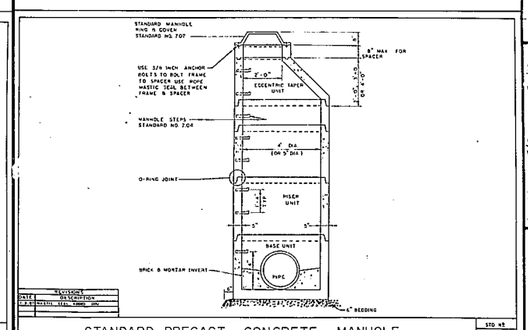

REVISIONS: DATE | DESCRIPTION

STANDARD PRECAST CONCRETE MANHOLE — STD NO 7.03

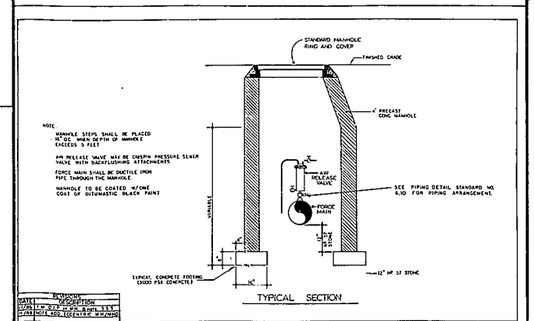

REVISIONS: DATE | DESCRIPTION — 5/3/90 | ADDED SEE PIPING DETAIL STD. NO. 6.00 FOR PIPING ARRANGEMENT

STANDARD AIR RELEASE MANHOLE
FOR SANITARY SEWER FORCE MAINS — STD NO. 7.14

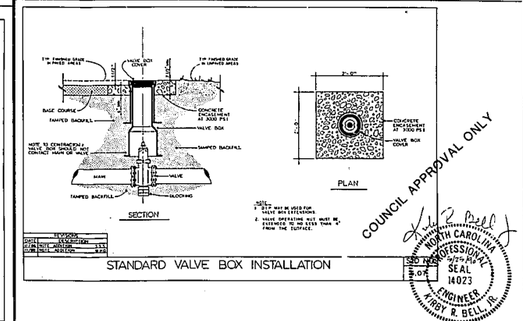

REVISIONS: DATE | DESCRIPTION — 5/3/90 | ADDED SEE PIPING DETAIL STD. NO. 6.00 FOR PIPING ARRANGEMENT; 5/3/90 | ADDED SECTION

STANDARD VALVE BOX INSTALLATION — STD NO 6.01

COUNCIL APPROVAL ONLY

NORTH CAROLINA PROFESSIONAL SEAL 14023 ENGINEER LEROY R. BELL JR.

TO BE CONSTRUCTED PER TOWN OF CARY STANDARDS.

Job Number _____ Book Number _____

BNK
BASS, NIXON & KENNEDY, INC., CONSULTING ENGINEERS
919/851-4422/7416 CHAPEL HILL ROAD, RALEIGH, N. C. 27607

REVISIONS: NO | DATE
1 | 7/25/90
2 | 12/4/90

BNK | DRAWN BY
8/90 | DATE
MISCELLANEOUS DETAILS
SCALE

PHASE ONE
OZELLE LANGSTON SUBDIVISION
SWIFT CREEK TOWNSHIP, WAKE COUNTY, N. C.
DEVELOPER: COMMUNITY PROPERTIES, INC.

SHEET 15 OF 15