


INTERIOR  
FLOOR PLAN - LIGHTING PLAN  
SCALE: 1/8" = 1'-0"



- NOTES**
- ALL WORK SHOWN SHALL COMPLY WITH ALL NATIONAL, STATE AND LOCAL CODES, ORDINANCES, ETC.
  - SEE LUMINAIRE SCHEDULE AND DETAILS, DRAWING E4.1, FOR INFORMATION.
  - SEE DETAILS ON DRAWINGS E2.1B AND E2.1C FOR LIGHTING PANEL "LP-1" AND SIGN PANEL, LP-20" CONTROL SCHEDULE AND WIRING.
  - SEE GENERAL NOTE 3, ON DRAWING E2.1 FOR EMERGENCY AND EXIT LUMINAIRE INFORMATION.
  - LUMINAIRES INSTALLED IN CONTIGUOUS ROWS SHALL BE GROUNDED WITH A CONDUCTOR ROUTED FROM LUMINAIRE TO LUMINAIRE, MOUNTED TO EACH WITH GROUNDING LUG OR SOLDER. ALIGNING CLIPS ARE NOT ACCEPTABLE. LUMINAIRE GROUNDING SHALL BE INSTALLED IN COMPLIANCE WITH NATIONAL ELECTRICAL CODE, ARTICLE 410-21.
  - DO NOT CONNECT EMERGENCY LIGHTS OR EXIT SIGNS WITH ANY OTHER LUMINAIRE. PROVIDE COMPLETELY SEPARATE RACEWAY SYSTEM ONLY WHERE REQUIRED, SUCH AS CHICAGO. CONNECT TO NORMAL ELECTRICAL SYSTEM WHERE ACCEPTABLE TO THE LOCAL CODE AUTHORITY.
  - "M" LUMINAIRE LENGTHS SHOWN FOR REFERENCE ONLY. LUMINAIRE LENGTHS DEPEND ON THE LOCATION OF FINISHED END SHOWN ON DRAWING D-1 (FUTURE PLAN). PROVIDE 6" SPACE MAXIMUM FROM FINISHED END TO LUMINAIRE. DO NOT PROVIDE MORE THAN 6" OF UNLIGHTED AREA AT THE END OF SHELVING. OVERLAP "M" LUMINAIRES IF REQUIRED. CONTACT THE PROJECT ARCHITECT FOR A COPY OF DRAWING D-1.
  - LIGHTING FOR WALK-IN COOLER/FREEZER UNIT TO BE WALL SWITCHED.
  - STOCK AREA LIGHTING TO BE MOUNTED ABOVE AISLE. DO NOT MOUNT ABOVE SHELVING.
  - NOT USED.
  - CEILING LIGHTS ARE TO BE WIRED TO THE BAR JOIST MEMBERS AT THE DIAGONAL CORNERS.
  - CONDUIT SHALL BE ELECTRICAL METALLIC TUBING (EMT), RIGID STEEL (E" MIN.), OR MC CABLE WHERE ALLOWED BY CODE.
  - PROVIDE EMERGENCY LIGHTING TO MEET THE REQUIRED FOOT CANDLE LEVEL PER LOCAL CODE.
  - FOR EMERGENCY UNIT BATTERIES FED FROM CIRCUITS 2 & 6, REFER TO DETAIL 4 DRAWING E2.1C FOR WIRING.

- LIGHTING KEYED NOTES**
- LUMINAIRE "O", HEIGHT AS NOTED.
  - LUMINAIRE "TS", RECESSED CANOPY LUMINAIRE WIRED FROM SIGN PANEL "LP-SP".
  - NIGHT LIGHTS (TO BE CIRCUITED AND SWITCHED SEPARATELY).
  - OCCUPANCY SENSOR, PURCHASE THROUGH NATIONAL ACCOUNT (SEE NOTE III AND SCHEDULE ON DRAWING E4.1). (LAYOUT OF OCCUPANCY SENSORS SHOWN IN PLAN IS FOR LEVITON. ~~SEE DRAWING E4.1 FOR LEVITON OCCUPANCY SENSORS.~~)
  - NOT USED.
  - NOT USED.
  - OUTLET BOX IN WALL, 8"-10" A.F.F., CONNECT TO CORNICE MOUNTED LUMINAIRE. (LENGTH AS NOTED). SEE NOTE 7 AND DETAILS 1 AND 2/E4.1. COORDINATE TO AVOID WALL SHELVING STANDARD.
  - RECESSED SLIMLINE LUMINAIRE, SEE LUMINAIRE SCHEDULE, DRAWING E4.1.
  - OUTLET BOX ABOVE CEILING FOR RECESSED LUMINAIRE "S".
  - NOT USED.
  - NOT USED.
  - LUMINAIRE "Q", SEE ARCHITECTURAL EXTERIOR ELEVATION DRAWING A4.4 FOR MOUNTING.
  - LUMINAIRE "O", MOUNTED ABOVE WINDOW HEADER. COORDINATE WITH ARCHITECTURAL DRAWINGS A2.3 & A2.4 FOR FIXTURE LOCATION.
  - ~~SEE DRAWING E4.1 FOR LUMINAIRE "O" MOUNTING ABOVE WINDOW HEADER.~~
  - FOR LEFT HAND ENTRY STORES (MIRROR IMAGE) ADD LUMINAIRE "O" TO DRIVE-THRU ELEVATION IN LIEU OF "E-3" @ +9'-0".
  - ~~SEE DRAWING E4.1 FOR LUMINAIRE "O" MOUNTING ABOVE WINDOW HEADER.~~
  - RECESSED DOWNLIGHT LUMINAIRE TYPE "L", COMPACT FLUORESCENT. SEE LUMINAIRE SCHEDULE, DRAWING E4.1.
  - EMERGENCY EGRESS LUMINAIRE "E-3" SEE SHEET E4.1 FOR WALL MOUNTED, EMERGENCY EGRESS LUMINAIRE "E-3" SEE SHEET E4.1 FOR DETAILS.
  - LUMINAIRE "O", MOUNTED ABOVE WALK-IN COOLER/FREEZER UNIT FOR MAINTENANCE OF EQUIPMENT (SWITCH AS SHOWN).
  - NOT USED.
  - SURFACE MOUNTED POWER PACK "E-4". SEE LUMINAIRE SCHEDULE, DRAWING E4.1.
  - NOT USED.
  - LUMINAIRE "O", WALL MOUNT SURFACE LUMINAIRE MOUNT "B" A.F.F. (SEE SHEET E4.1 FOR WALL MOUNT SURFACE LUMINAIRE MOUNT "B" A.F.F. DETAILS).
  - FACE Accent fixture, LUMINAIRE TYPE "M", MOUNT ON TOP OF AWNING. SEE LUMINAIRE SCHEDULE, DRAWING E4.1. LIGHTS SHALL BE DIRECTED AS TO LIGHT ONLY THE STORED MERCHANDISE & PESTICIDE PRODUCT.
  - PROVIDE DOWNLIGHT LUMINAIRE TYPE "L", COMPACT FLUORESCENT. SEE LUMINAIRE SCHEDULE, DRAWING E4.1.
  - PHARMACY LOCAL OVERRIDE LOW VOLTAGE MOMENTARY SWITCHES. REFER TO DRAWING E2.1B AND E2.1C FOR CONTROL WIRING DETAILS.
  - PROVIDE 200W OUTLET W/ RECEPTACLE FLUSH MTD IN WINDOW JAMB @ E-4" AFF FOR ROPE LIGHT. CONNECT TO LPI-31. PROVIDE ROPE LIGHT AT BOTTOM OF EACH WINDOW (15' OF LAMPS). RUN DEAD LEAD UP TO OUTLET & PLUG IN. ROPE LIGHT = CELESTIAL (OR EQUAL), LAMPS 1" D.C. LINE VOLTAGE.

**LEGEND**

	FLUORESCENT LIGHTING - SEE DRAWING E4.1 FOR LUMINAIRE SCHEDULE AND DETAILS.
	FLUORESCENT NIGHT LIGHT
	EXTERIOR LUMINAIRE (WALL MOUNTED)
	OUTLET (WATTAGE AND LOCATION AS NOTED)
	OUTLET, WALL MOUNTED (WATTAGE AND LOCATION AS NOTED)
	EXIT LIGHT: "E" (CEILING MOUNTED WITH PENDANT)
	EXIT LIGHT: "E" (WALL MOUNTED)
	EMERGENCY LIGHT: "E-1" (WALL/COLUMN MOUNTED)
	EMERGENCY LIGHT: "E-2" (CEILING GRID MOUNTED)
	SWITCH
	SWITCH WITH PILOT LIGHT
	SWITCH, 3-WAY
	MOTION SENSOR SWITCH, ARROW INDICATES DIRECTION OF RECEIVER (IF APPLICABLE)
	SPEAKER.

**James Douglas Evans Architects, PLLC**  
 350 NORTH EAST AVENUE  
 FAYETTEVILLE, NORTH CAROLINA 28404  
 330-633-9225 voice 330-633-9211 fax

**PROJECT TYPE**

DRAWINGS/SPECIFICATIONS BY:  
 WALGREENS  
 LANDLORDS CONSULTANT  
 ALL CONSTRUCTION WORK, UNLESS NOTED OTHERWISE, BY:  
 WALGREENS CONTRACTOR  
 LANDLORDS CONTRACTOR (TURNKEY CONSTRUCTION)

STORE	BUILDING
NEW <input checked="" type="checkbox"/>	NEW <input checked="" type="checkbox"/>
REMODELING <input type="checkbox"/>	EXISTING <input type="checkbox"/>
RELOCATION <input type="checkbox"/>	NEW SHELL ONLY <input type="checkbox"/>
OTHERS <input type="checkbox"/>	

**BALACH ASSOCIATES**  
 10354 SAUNDERS DR.  
 GREENSBORO, NC 27410 440-372-3941  
 E-Design@balach.com

**NOTE:**  
 XXXXXX  
 CROSS HATCHING DENOTES ITEMS THAT ARE NOT USED. REFERENCE TO SUCH ITEMS SHALL BE DELETED FROM THE SCOPE OF WORK FOR THIS PROJECT.

06-SP-012  
 APPROVED  
 TOWN OF CARY  
 Approved by: *[Signature]* Date: 7/27/06  
 Planning: *[Signature]* Date: 7/11/06  
 Engineering: *[Signature]* Date: 7/12/06

NO.	DATE	BY	REVISIONS PER TOWN OF CARY	DESCRIPTION	COMST
1	06-27-06			REVISIONS PER TOWN OF CARY	

**CERTIFICATION AND SEAL**

I HEREBY CERTIFY THAT THIS PLAN AND SPECIFICATION WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT OR ENGINEER UNDER THE LAWS OF THE STATE OF NORTH CAROLINA AS SIGNIFIED BY MY HAND AND SEAL.


*[Professional Seal]*

STORE NO. 10541  
 PROJECT NAME  
*Walgreens*  
 WRENN DR. / KILDAIRE FARM RD. ARCHITECTS' PROJECT NUMBER: 3705  
 DRAWING TITLE

**FLOOR PLAN-LIGHTING**

CADD PLOT: SCALE AS NOTED  
 VOID PLOT: DRAWN BY: MMB  
 RELEASED TO CONSTRUCTION: DATE: 04-21-06  
 REVIEWED BY: LBR

**E1.1**

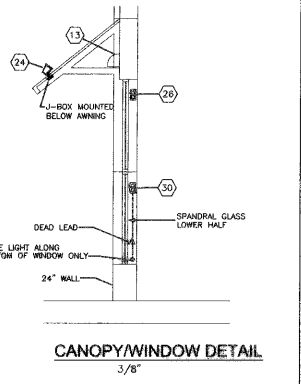

CANOPY/WINDOW DETAIL  
 3/8"