


REVISIONS
 1. REVISIONS FOR PERMITS & CONSTRUCTION CONTRACTS
 12/11/1993


GEORGE FINCH, LANDSCAPE ARCHITECT, P.A. / LANDSCAPE ARCHITECTURE
 601 OBERLIN ROAD, SUITE 200
 RALEIGH, NORTH CAROLINA 27605
 919/853-1212

A PROJECT BY THE CENTRE GROUP
PARKWAY ANIMAL HOSPITAL
 NCSR 1011 (OLD U.S. 1)
 CARY, NORTH CAROLINA

DRAWN BY ABC
 CHECKED BY GMF
 PROJECT NO. 93-37
 DATE 29 DEC. 1993
 SHEET 1-6 OF

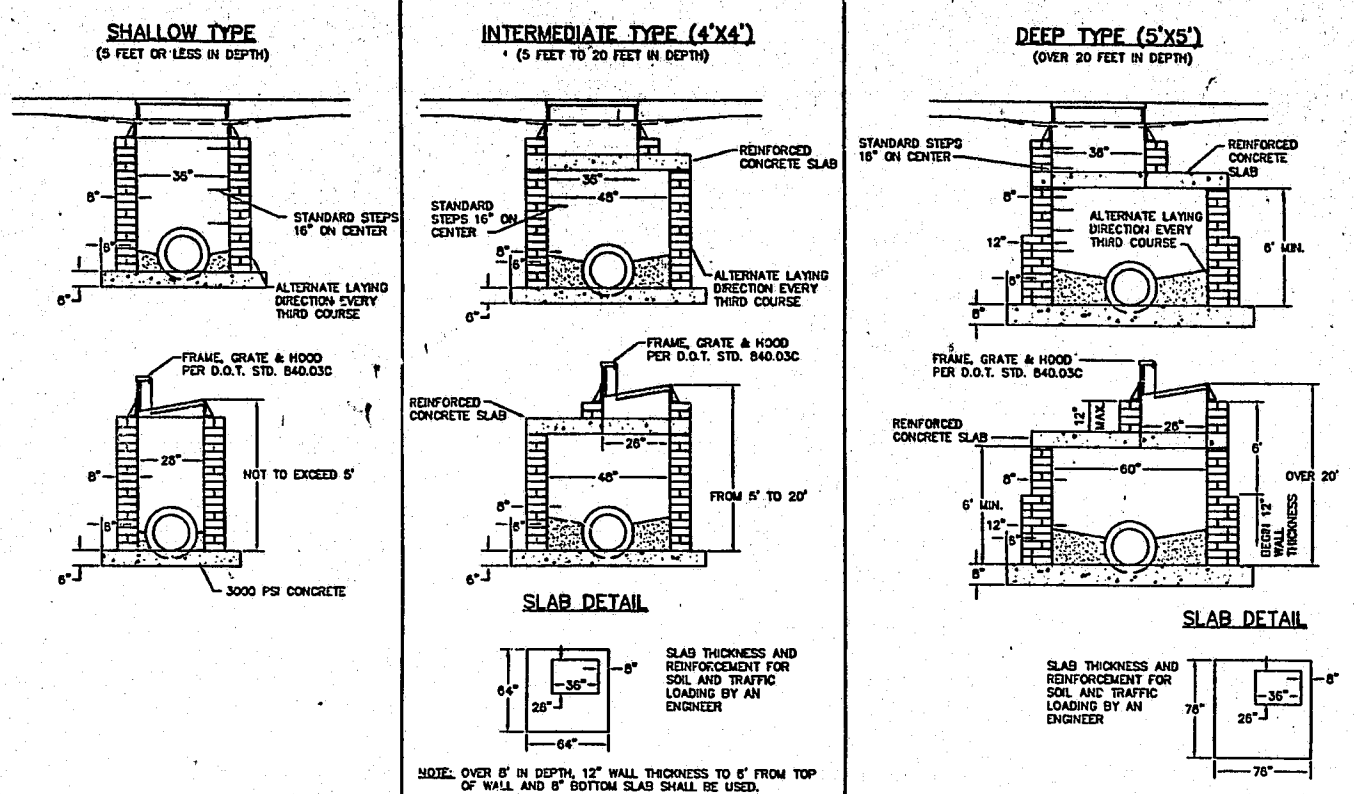


1 CURB INLET
 SCALE: NOT TO SCALE

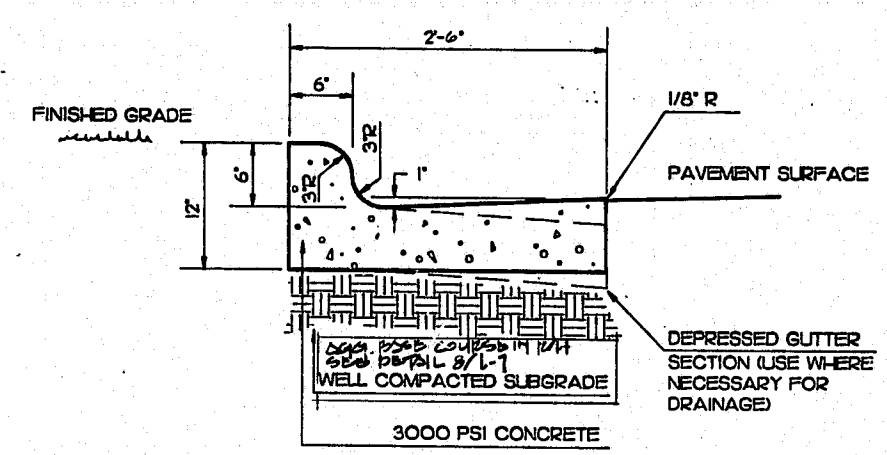


- NOTES
- 1) CURB AND GUTTER SHALL BE LAID IN 10' LENGTHS WITH 1/8" METAL SPACERS.
 - 2) EXPANSION JOINTS SHALL BE SPACED AT 40' INTERVALS

2 CURB & GUTTER
 SCALE: 1" = 1'-0"

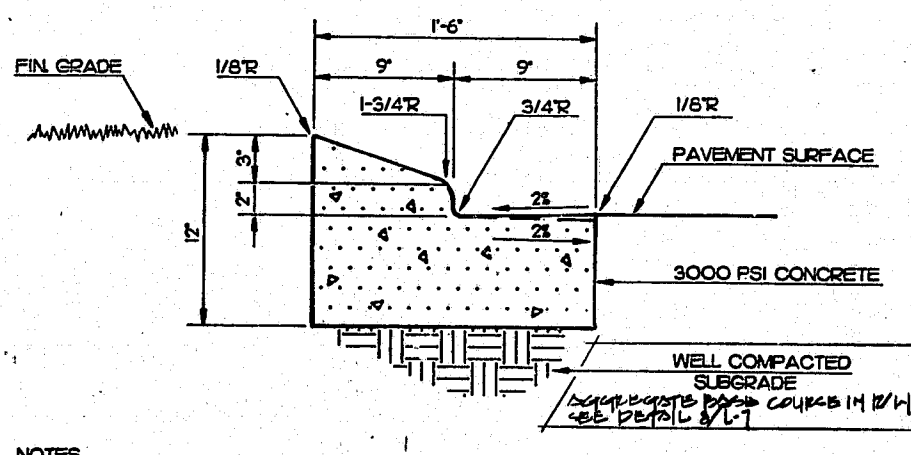


- NOTES
- 1) CURB AND GUTTER SHALL BE LAID IN 10' LENGTHS WITH 1/8" METAL SPACERS.
 - 2) EXPANSION JOINTS SHALL BE SPACED AT 40' INTERVALS.

3 MEDIAN CURB
 SCALE: 1/2" = 1'-0"

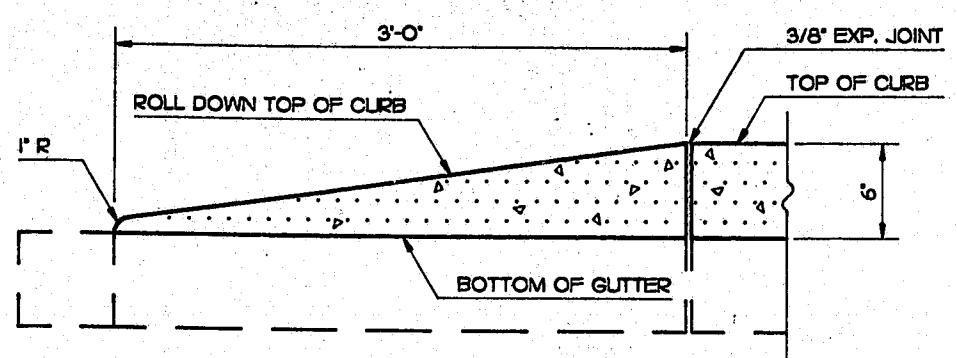


4 CURB TAPER
 SCALE: 1/2" = 1'-0"

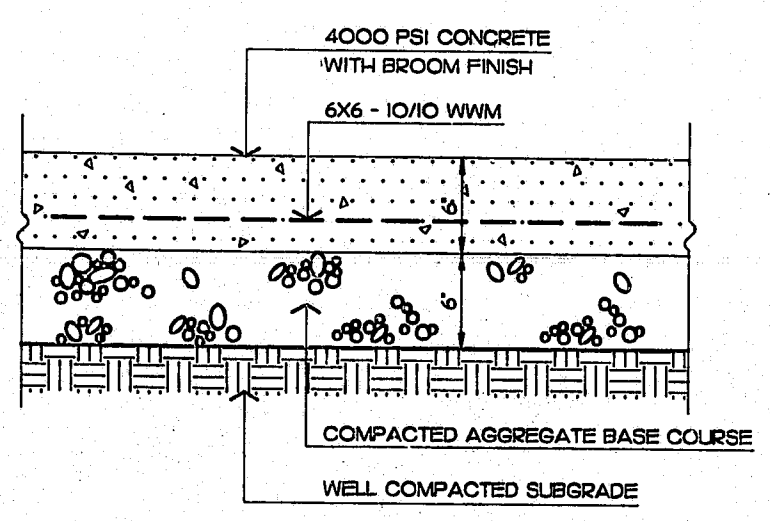


- NOTES
- SEE SHEET L-1 FOR JOINTING PLAN
 SEE L-6 FOR JOINTING DETAIL

5 CONCRETE PAVEMENT
 SCALE: 1/2" = 1'-0"

- NOTES
- 1) WALKS SHALL BE CONSTRUCTED OF 3000 PSI CONCRETE ON A WELL COMPACTED SUBGRADE
 - 2) WALKS SHALL HAVE BROOM FINISH UNLESS OTHERWISE NOTED
 - 3) SEE DETAIL L-1 FOR JOINTING

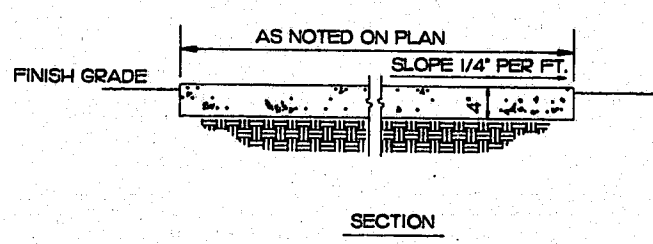


SECTION

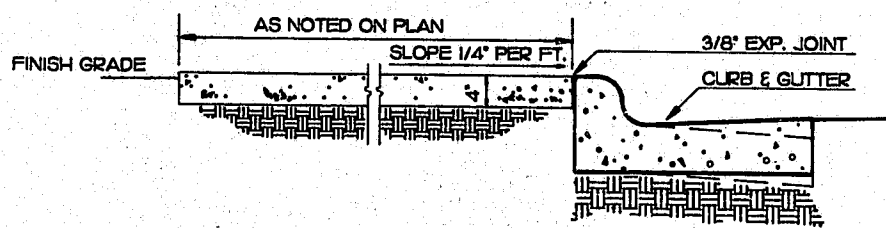


WALK AT CURB - SECTION

6 CONCRETE WALK
 SCALE: 3/4" = 1'-0"

SAW-CUT OR TOOLED JOINT WHERE SPECIFIED
 1" DEPTH FOR CONCRETE WALKS
 1/2" DEPTH FOR CONCRETE PAVEMENT
 FINISH AS NOTED ON PLANS

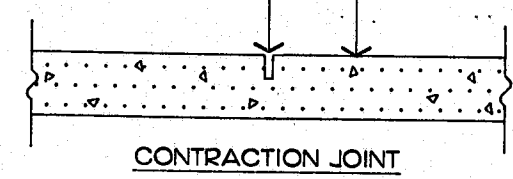


3/8" EXPANSION JOINT WITH MULTI-COMPONENT URETHANE SEALANT WITH REQUIRED PRIMER

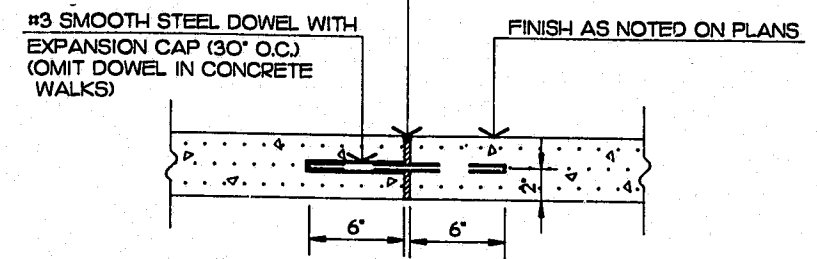


EXPANSION JOINT

- NOTES
- 1) ON CONCRETE WALKS, CONTRACTION JOINTS SHALL BE SPACED AT AN INTERVAL EQUAL TO THE WIDTH OF THE WALK, BUT SHALL NOT EXCEED 6' O.C.
 - 2) ON CONCRETE WALKS, EXPANSION JOINTS SHALL BE PLACED AT A MAXIMUM OF 30' O.C.
 - 3) SEE SHEET L-1 FOR SPACING OF JOINTS IN CONCRETE PAVEMENT.

7 CONCRETE JOINTS
 SCALE: 1/2" = 1'-0"

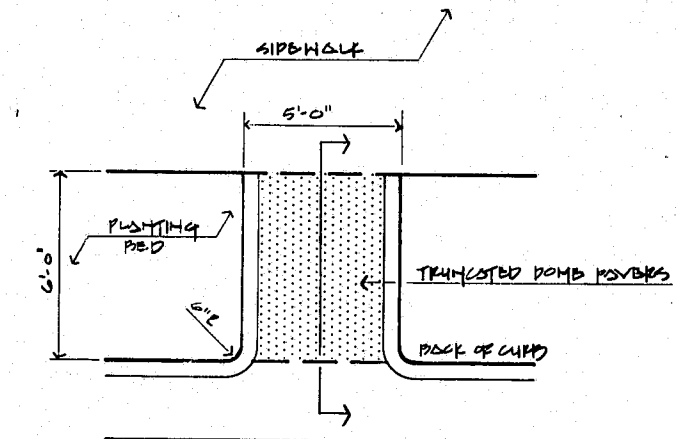

PLAN
 SCALE: 1/4" = 1'-0"

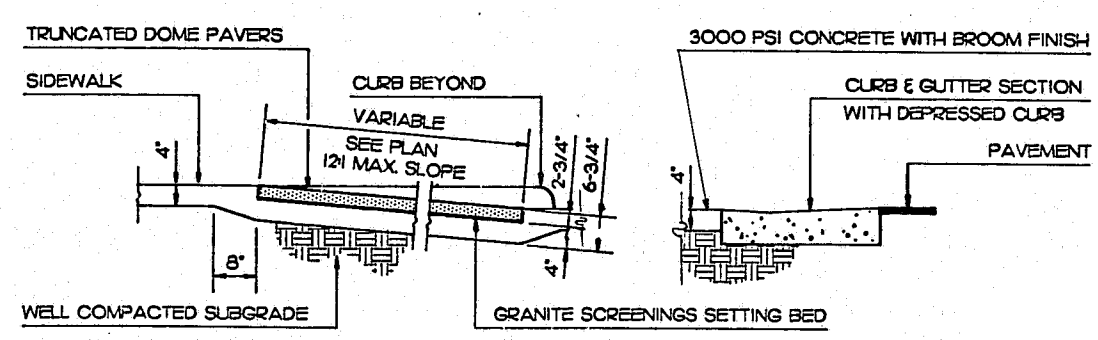

SECTION
 SCALE: 1/2" = 1'-0"

- NOTES
- 1) THE WALKING SURFACE SHALL BE SLIP-RESISTANT. DETECTABLE WARNING DOMES SHALL COVER THE FULL WIDTH AND LENGTH OF THE RAMP SURFACE. THE DETECTABLE WARNINGS SHALL CONSIST OF RAISED TRUNCATED DOMES WITH A DIAMETER OF NOMINAL 0.9", A HEIGHT OF 0.2", AND A CENTER-TO-CENTER SPACING OF 2.35". THE RAMP SHALL BE A COLOR WHICH PROVIDES A 70% CONTRAST RATIO TO THE ADJACENT CONCRETE WALK.

8 HANDICAP RAMP
 SCALE AS SHOWN

CONSTRUCTION DETAILS
 SCALE AS SHOWN

